# SSW900 - SOFT-STARTER

Power and full protection to the motor





Motors | Automation | Energy | Transmission & Distribution | Coatings



Soft-starters are devices dedicated to the smooth acceleration and deceleration of three-phase induction motors by controlling the voltage applied to it.

Combining convenience and innovation, the SSW900 is the right choice for a complete motor protection and start/stop control. Developed for industrial or professional use, the new line of soft-starters allows simple and quick access to application information and configuration settings.

Using a well structured menu interface, the SSW900 line presents an unprecedented experience of interactivity with the user, allowing adjustments and configurations allied to on-line parameter help right on the HMI, in addition event logs with date and time and setup assistant are also available. The equipment brings also a built-in bypass, which contributes to extending the life time of the soft-stater, optimizing space and reducing heat dissipation inside electric panels.





## **POWER AND FULL PROTECTION** TO THE MOTOR



Note: 1) Please consult the availability of certification with your sales representative.






#### Characteristics

- Current ranges from 10 to 1,400 A
- Supply voltage from 220 to 575 V ac
- Oriented start-up
- Standard connection (3 cables) or motor inside delta connection (6 cables)
- Elimination of starting mechanical shock to couplings and driven equipment
- Pump control function for smart control of pumping systems that prevent water hammer and pressure overshoots in the hydraulic piping

- Integral motor thermal protection
- Increased motor and equipment lifetime
- Reduction of voltage drops during motor start
- Great mechanical stresses reduction on the couplings and transmission devices (gear boxes, pulleys, gears, belts, etc.) during the motor start
- Operation at ambient temperature up to 55 °C without current<sup>1)</sup> derating
- Three braking methods to stop the motor and the load faster. Braking methods with or without an external contactor
- Built-in bypass: minimizing power losses and heat dissipation in the thyristor, providing space reduction, contributing to energy saving and increasing the product's life.






Note: 1) Models A to D.

- The SSW900 can substitute direct online starters or star-delta starters, bringing benefits to your application, such as:
- Electric energy savings
- Greater protection and increased durability of the electric motor
- Diagnosis and fault history
- Flexibility, it allows the installation of accessories in the application (plug and play)
- Graphic monitoring
- Customizable main screens









Note: 1) HMI with Bluetooth connectivity available as an

accessory item. Please consult availability of certification for your region.



## Adjustable Protections

The SSW900 uses advanced techniques to detect supply line and connection faults, allowing the user to choose the actuation mode of protections (fault or alarm) for total motor protection:

- Programmable protections for overvoltage, undervoltage, voltage imbalance between phases and phase sequence
- Programmable protections for motor overload and underload
- Thermal protections through Pt-100 reading and motor heating and cooling curves
- Overcurrent and undercurrent, current imbalance, undertorque and overtorque, underpower and overpower
- Protections against short-circuit on the power side
- Bypass protections (overcurrent, undercurrent and failure in the bypass contactor opening)
- Minimum time interval between starts
- Protections against communication faults
- Actuation of the programmable protections between fault or alarm
- Fault auto-reset

## Start and Stop Control Methods

The SSW900 offers, through its algorithm, flexibility and high performance control to meet application requirements on start and stop cycles of three-phase induction motors.

|                              |       | Actuation |  |
|------------------------------|-------|-----------|--|
|                              | Start | Stop      |  |
| Voltage ramp                 |       |           |  |
| Voltage ramp + current limit |       |           |  |
| Current limit                |       |           |  |
| Current ramp                 |       |           |  |
| Pump control <sup>1)</sup>   |       |           |  |
| Torque control <sup>2)</sup> |       |           |  |
| D.O.L SCR                    |       |           |  |
| Coast to stop                | X     |           |  |

Notes: 1) The setting of the function Pump Control is allowed for stopping the motor only when it is used at the starting as well. 2) The setting of the function Torque Control is allowed for stopping the motor only when it is used at the starting as well.

## **Main Features**



Forward / Reverse

Jog









#### Fire mode (emergency start)

Allows starting and stopping the motor in emergency situations, even when any fault occurs, disregarding the SSW or motor protections. Used to drive hydraulic pumps for firefighting systems.



#### High performance graphic HMI

Indication of all variables of the motor or SSW in an easy and intuitive way, using many units and formats, through bar graphs or time graphs.



#### Diagnosis

Several status of the SSW are saved at certain moments to facilitate the diagnosis of faults and problems in the application or in the motor. For instance:

- Faults, with history of all faults and storage in CSV file
- Alarms, with history of all alarms and storage in CSV file
- Event history with storage in CSV file
- All saved information goes with RTC time and date stamp

| 18280-318-8 s                             | 145                    |                        |           |                          |  |   |   |   |  | houte   | 2.5   |  |  |                            |   |
|---|------------------------|------------------------|-----------|--------------------------|--|---|---|---|--|---|---|--|--|----------------------------|---|
| 8   |                        |                        |           |                          |  |   |   |   |  | 16.0  | 10  |  |  |                            |   |
| - Cole Deurgtur                           | bered the              | Genetic Can            | er100 : 0 | arest T-00               | All investors (1)  | STax-sharts 14  | and and a state   | and a strength of   | -  | with Distributer  |   |  |  |                            |   |
| 701 Substando sa Almantado do Mara        | 2010-01-01-01-02-04    | 12 12                  |           |                          | 129.7  | 394.8 352   |   |   | 10.000                                       |   |   |  |  |                            |   |
| Plat Serge Drive Faridae                  | 208-01-0-09/02/58      | 81 81                  | - 81      | 5                        | 27.4   | 24.3 26   | 1 - 6   |   | <u>c                                    </u> | Targa Antere<br>Testa Pocal   | <u> </u>  |  |  |                            |   |
| PIDE Dedaleveraneto-in Tende ro-Max       | 2016-02-22 17-23-05    | 34 34                  | - 21      | 3                        | 218.1  | 191 16  | 1 10  |   | <u> </u>                                     | ham   | -   |  |  |                            |   |
| P000 Falla de Pareiro Parisio de Peter    | 2010-10-2217-2017      | 14 2.6                 | 0.0       | ***                      | -d- 1 +  |   |   |   | ~  | and the second se |   |  |  |                            |   |
| PED Falls & Face to Particle do Hotor     | 2016-10-05-01-22-59    | 81 81<br>87 87         |           |                          |  |   |   |   |  | 29-1-1-2-10-20-20-20-20-20-20-20-20-20-20-20-20-20  | bee .   |  |  |                            | T # # # 1   |
| Pat Secretorulte                          | 2016/11/16 (01:06:02   | 87 87                  | MORE      | 1674                     | NUM NOW  | under techique  | IONAUS SHO  | s enko  | track.                                       |   |   |  |  |                            | Star-Indian Triagence   |
| F PIEL Falade Face null activate Nature   | 2016/12/16 10:12/15    | 342                    | 0.1       | Annes                    | Sala   | 10000   |   |   |  |   |   |  |  |                            |   |
| 1 Pith Schedende in Rivertigde & Poter    | 2014-01-04 05-02-40    | 34 34                  | 10.       | Infante 1                | 1.004  | 100 T K X   |   | (Plane)   | ats hat makes                                | nete liest  | h   | 10 1   | 2 11 28 1  | TAblan                     | T 8   |
| 1 Pith Salestanda sa Almeria da Nota-     | 2016/11-06 10:10 10:00 | 34 34                  | Caler .   | Church I                 |  | 1-12- A-4-  |   | Descent   | Cambra 1                                     | 17 - 1. m   | to a linear   | in Terrate const bills                       | and these datas its  | Trancler                   | Uniter Index  |
| I Hit Debarramenta de Tenda na Matar      | 2014-12-36 10:12 50    | 32 33                  |           |                          |  | -   |   |   |  |   | Conking .   |  | Ar 1. 1  | <ul> <li>Eimper</li> </ul> | affine biscore-   |
| 1 PDN Debalancements de Carrente no Plate | 2040-049023            | 34                     |           | # Series                 |  | Auto 14   |   | and particular.   |  | 5 50448   | 6   | 1.04   | 14.00  |                            | 10yle   |
|   | Descriptor Quande a di | loungs with a subley   | 40.00     |                          | 5 × 4  |   |   |   |  |   |   |  |  |                            |   |
|   | percentages da textile | naminal do matter (C   | 21        |                          |  |   |   |   |  |   |   |  |  |                            |   |
|   | (CI112), durate unit   |                        |           |                          |  | 1   |   | 1.  | 1 6  |   |   |  |  | · · · · ·                  |   |
|   | debalanceariants det   |                        |           | g Ork                    | Description  |   |   |   | eet's Gere                                   |   |   | (i) Million-ship:                            |  | () 10 Supervises           |   |
|   | derapplitests - labs   | ie umo fece-sa inde de | 1 C       | 1991                     | School and a state   | sertação de bistrar   | 34,492,3634,694   |   | 14   | 1047  | 0.944   | 3915   | 385  |                            | Ratigs Antiengle  |
|   |                        |                        | 1.1.2     | 7961                     | Seeparate Autority   |   | 14/01/2014 010  |   |  | 267.6   | 3943  | 28-2   | 387  |                            | Televisid   |
|   | Landaran               |                        |           |                          |  |   |   |   | 4.8  |   |   |  |  |                            | Reni  |
|   |                        |                        | 157       | FREE                     |  | de frende na étator   | 1010100-011   |   |  | 2083  | 191   | 263  | 2014   |                            |   |
|   |                        |                        | 12        | 100.                     | Full a de Facie na Par   | 10.000  | 1010309-012   | 142 14  | 1.0  | 8.8   | 84  | 8.0  | 305.0  | 2                          | Totestid  |
|   |                        |                        | 8         | 795.<br>795<br>795       | Patta de Faire Na Pat<br>Patta de Faire Na Pat   | nda da Nottar<br>Eda de Nottar  | 2020/004172<br>26/32/004452   | 042 HJ  | 8.0  | 8.8<br>8.9  | 84  | 10   | 2011<br>2014   |                            | Televisial  |
|   |                        |                        | 100       | 10.00                    | Falls de Faix sa Par<br>Falls de Faix sa Par<br>Salis anendo se Tel  | tuda da falotar<br>Tuda da falotar<br>Tur   | 2010/00/01/1<br>26/12/20/01/1<br>26/12/20/01/1  | 142 43<br>143 43<br>147 47  | 10<br>10                                     | 8.8<br>8.9<br>207.8   | 84<br>84<br>204   | 80<br>80<br>2014                             | 8811<br>8814<br>8815   | 8                          | Notice and Appendix   |
|   |                        |                        | 10000     | 790                      | Futballe Faire sa Fai<br>Futballe Faire sa Fair<br>Subscription on Third<br>Futballe Faire sa Fair   | tada da Mattar<br>Tada da Mattar<br>Lata da Mattar  | 2010/00/07/12<br>2012/2010/07/2<br>2012/2010/07/2<br>2012/2010/07/2                     | HA2 HA3<br>HA2 HA3<br>HA2 HA3<br>HA2 HA3  | 10<br>10<br>10                               | 84<br>83<br>2078<br>89  | 848<br>848<br>2004<br>848                               | 8.0<br>8.0<br>2014<br>8.0                    | 8461<br>8864<br>2863<br>2869                                 |                            | Noticeald<br>Repet<br>Televisial  |
|   |                        |                        | 10.5      | 790<br>790<br>790        | Patta de Paix na Pat<br>Patta de Paix na Pat<br>Patta de Paix na Pat<br>Patta de Paix na Pat<br>Subratonita na Alt                         | tala la Aletar<br>Inde de Militar<br>Inf<br>Cala de Militar<br>Incelação de Militar   | 2010/00/04/11<br>2012/2010/04/02<br>2012/2010/04/02<br>2012/2010/2010<br>2012/2010/2010 | 142 40<br>143 40<br>143 40<br>143 40<br>143 40  |  | 8.8<br>8.9<br>20 <sup>9</sup> 8<br>8.9<br>2044  | 848<br>848<br>2004<br>848<br>2054                       | 84<br>84<br>2014<br>84<br>2014               | 2011<br>2013<br>2013<br>2014<br>2014                         | 8                          | Note said<br>Report<br>Note said<br>Respirationage                                      |
|   |                        |                        | 35        | 780<br>780<br>780<br>780 | Patta de Pais sa Pat<br>Patta de Pais sa Pat<br>Salvaneste se Not<br>Patta de Pais sa Pat<br>Salvaneste sa Ale<br>Salvaneste de Salvaneste | tala da Mattar<br>Tala da Mattar<br>Kala da Mattar<br>Manda (da Mattar<br>Mantagila da Mattar<br>Mantagila da Mattar  | 2010/01/04 212<br>2012/2010/01/02<br>2012/2010/01/02<br>2012/2010/2010                  | (42) 43<br>(43) 43<br>(42) 43<br>(42) 43<br>(43) 43<br>(44) 44<br>(44) 44<br>(44) 44<br>(44) 44<br>(44) 44  |  | 8.4<br>8.9<br>20 <sup>2</sup> 8<br>8.9<br>2044<br>2044  | 84<br>84<br>204<br>85<br>85<br>85<br>85<br>8<br>25<br>8 | 10<br>10<br>204<br>10<br>201<br>201          | 2013<br>2013<br>2014<br>2014<br>2014<br>2014                 |                            | Note mit#<br>Begen<br>Note mit#<br>Respirationalle<br>Respirationalle                   |
|   |                        |                        | 8         | 100 100 100 100 100      | Patta de Paix na Pat<br>Patta de Paix na Pat<br>Patta de Paix na Pat<br>Patta de Paix na Pat<br>Subratonita na Alt                         | tala da Mattar<br>Tala da Mattar<br>Kala da Mattar<br>Manda (da Mattar<br>Mantagila da Mattar<br>Mantagila da Mattar  | 2010/00/04/11<br>2012/2010/04/02<br>2012/2010/04/02<br>2012/2010/2010<br>2012/2010/2010 | HQ         HQ           HQ         HQ |  | 84<br>83<br>84<br>84<br>84<br>84<br>84<br>84<br>84<br>84<br>84<br>84<br>84<br>84<br>84  | 84<br>2014<br>2014<br>2014<br>2014<br>2014<br>2018      | 10<br>204<br>274<br>271<br>271<br>271<br>271 | 2003<br>2003<br>2004<br>2004<br>2004<br>2004<br>2004<br>2004 |                            | Notemine<br>Report<br>Notemine<br>Respirationally<br>Respirationally<br>Respirationally |
|   |                        |                        | 10.00     |                          | Patta de Pais sa Pat<br>Patta de Pais sa Pat<br>Salvaneste se Not<br>Patta de Pais sa Pat<br>Salvaneste sa Ale<br>Salvaneste de Salvaneste | tala da Alaktar<br>Kala da Alaktar<br>Kala da Alaktar<br>Kala da Alaktar<br>Kala da Alaktar<br>Kala da Alaktar<br>Kala da Kalaktar<br>Kala da Kalaktar<br>Jaj Tumula wa Klaktar | 2010/01/04 212<br>2012/2010/01/02<br>2012/2010/01/02<br>2012/2010/2010                  | HQ         HQ           HQ         HQ |  | 8.4<br>8.9<br>20 <sup>2</sup> 8<br>8.9<br>2044<br>2044  | 84<br>84<br>204<br>85<br>85<br>85<br>85<br>8<br>25<br>8 | 10<br>10<br>204<br>10<br>201<br>201          | 2013<br>2013<br>2014<br>2014<br>2014<br>2014                 |                            | Note mit#<br>Begen<br>Note mit#<br>Respirationalle<br>Respirationalle                   |




#### **Oriented Startup**

Guides the user on how to program the SSW900 easily.




## Connectivity

The SSW900 can be integrated to the main Fieldbus industrial communication networks, such as Profibus-DP, CANopen, DeviceNet and EtherNet/IP, using the appropriate plug-in module.

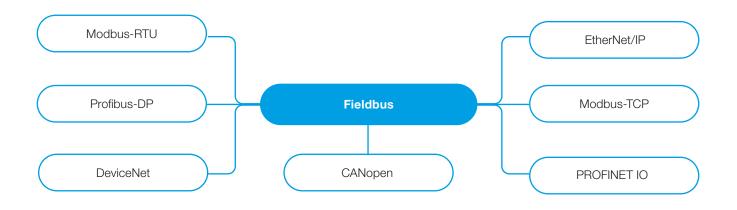

#### WEG Programming Suite (WPS)

WPS is an integrated PC software that assists in the creation of automation applications allowing graphical monitoring, parameterization and programming in Ladder language (IEC 61131-3) of several WEG product families.

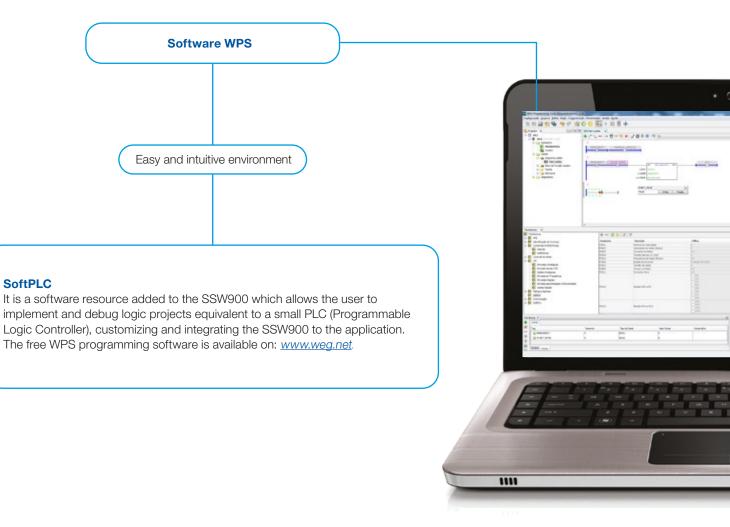



Note: 1) HMI with Bluetooth connectivity available as an accessory item.



## Applications







## Coding<sup>1)</sup>



## 1 - Soft-Starter SSW900

2 - Frame size of the SSW900, according to the table below

#### 3 - Rated output current, according to the table below

| Rated current  | Frame size |
|----------------|------------|
| 0010 = 10 A    |            |
| 0017 = 17 A    | - A        |
| 0024 = 24 A    |            |
| 0030 = 30 A    |            |
| 0045 = 45 A    |            |
| 0061 = 61 A    | - В        |
| 0085 = 85 A    |            |
| 0105 = 105 A   |            |
| 0130 = 130 A   |            |
| 0171 = 171 A   | С          |
| 0200 = 200 A   |            |
| 0255 = 255 A   |            |
| 0312 = 312 A   | - D        |
| 0365 = 365 A   |            |
| 0412 = 412 A   |            |
| 0480 = 480 A   |            |
| 0604 = 604 A   | E          |
| 0670 = 670 A   |            |
| 0820 = 820 A   | - F        |
| 0950 = 950 A   |            |
| 1100 = 1,100 A | - G        |
| 1400 = 1,400 A | ŭ          |

## 4 - Rated power supply voltage

| T5 |
|----|
|----|

## 5 - Rated electronic supply voltage

| E1 | Reserved                  |
|----|---------------------------|
| E2 | 110 - 240 V               |
| E3 | 110 - 130 V <sup>1)</sup> |
| E4 | 220 - 240 V <sup>1)</sup> |

Note: 1) Only for frame D, E, F and G.

#### 6 - Special hardware versions

| Blank | Electronic boards with coating class 3C2       |  |
|-------|--|--|
| EC    | Electronic boards with class 3C3 extra coating |  |

## 7 - Special software version

| Blank | Standard software |
|-------|-------------------|
| Sx    | Special software  |

Note: 1) Other configurations available upon request.





## Specification

The power ratings for the maximum applicable motor shown in the following tables are referential and valid for WEG 4-pole three-phase induction motors under light load conditions (e.g., centrifugal pump). Motor rated power may vary according to the motor data and application.

## **Standard Connection (with 3 Cables)**

| Model SSW900      | Rated current (A) |     | voltage<br>230 V | Motor<br>380/ | voltage<br>400 V | Motor<br>440/4 | voltage<br>460 V |       | voltage<br>5 V | Motor<br>57 | voltage<br>5 V |
|-------------------|-------------------|-----|------------------|---------------|------------------|----------------|------------------|-------|----------------|-------------|----------------|
|                   | А                 | HP  | kW               | HP            | kW               | HP             | kW               | HP    | kW             | HP          | kW             |
| SSW900A0010T5E2   | 10                | 3   | 2.2              | 6             | 4.5              | 7.5            | 5.5              | 7.5   | 5.5            | 10          | 7.5            |
| SSW900A0017T5E2   | 17                | 6   | 4.5              | 10            | 7.5              | 12.5           | 9.2              | 15    | 11             | 15          | 11             |
| SSW900A0024T5E2   | 24                | 7.5 | 5.5              | 15            | 11               | 15             | 11               | 20    | 15             | 20          | 15             |
| SSW900A0030T5E2   | 30                | 10  | 7.5              | 20            | 15               | 20             | 15               | 25    | 18.5           | 30          | 22             |
| SSW900B0045T5E2   | 45                | 15  | 11               | 30            | 22               | 30             | 22               | 40    | 30             | 40          | 30             |
| SSW900B0061T5E2   | 61                | 20  | 15               | 40            | 30               | 50             | 37               | 50    | 37             | 60          | 45             |
| SSW900B0085T5E2   | 85                | 30  | 22               | 60            | 45               | 60             | 45               | 75    | 55             | 75          | 55             |
| SSW900B0105T5E2   | 105               | 40  | 30               | 75            | 55               | 75             | 55               | 75    | 55             | 100         | 75             |
| SSW900C0130T5E2   | 130               | 50  | 37               | 75            | 55               | 100            | 75               | 125   | 90             | 125         | 90             |
| SSW900C0171T5E2   | 171               | 60  | 45               | 125           | 90               | 125            | 90               | 150   | 110            | 175         | 132            |
| SSW900C0200T5E2   | 200               | 75  | 55               | 150           | 110              | 150            | 110              | 200   | 150            | 200         | 150            |
| SSW900D0255T5Ex1) | 255               | 100 | 75               | 175           | 132              | 200            | 150              | 250   | 185            | 250         | 185            |
| SSW900D0312T5Ex1) | 312               | 125 | 90               | 200           | 150              | 250            | 185              | 300   | 220            | 300         | 220            |
| SSW900D0365T5Ex1) | 365               | 150 | 110              | 250           | 185              | 300            | 225              | 350   | 260            | 400         | 300            |
| SSW900D0412T5Ex1) | 412               | 150 | 110              | 300           | 220              | 350            | 260              | 440   | 315            | 450         | 330            |
| SSW900E0480T5Ex1) | 480               | 200 | 150              | 350           | 260              | 400            | 300              | 500   | 370            | 500         | 370            |
| SSW900E0604T5Ex1) | 604               | 250 | 185              | 450           | 330              | 500            | 370              | 600   | 450            | 650         | 485            |
| SSW900E0670T5Ex1) | 670               | 250 | 185              | 500           | 370              | 550            | 410              | 650   | 485            | 750         | 550            |
| SSW900F0820T5Ex1) | 820               | 350 | 260              | 550           | 410              | 700            | 525              | 800   | 600            | 850         | 630            |
| SSW900F0950T5Ex1) | 950               | 400 | 300              | 750           | 550              | 800            | 600              | 900   | 670            | 1,050       | 775            |
| SSW900G1100T5Ex1) | 1,100             | 450 | 330              | 800           | 600              | 900            | 670              | 1,100 | 810            | 1,200       | 900            |
| SSW900G1400T5Ex1) | 1,400             | 550 | 410              | 1,000         | 750              | 1,200          | 900              | 1,400 | 1,050          | 1,500       | 1,100          |

Notes: 1) To select a SSW900 model with control voltage 110-130 V, replace "x" by 3 and to select a model with control voltage 220-240, replace "x" by 4. Models ≤412 A: AC-53b 3-30:330, ambient temperature of 55 °C;

Models  $\geq$ 480 A: AC-53b 3-30:690, ambient temperature of 40 °C;

Models of 45 A to 200 A: with ventilation kit;

WEG motors Premium or Plus, IV pole.

#### Motor Inside Delta Connection (with 6 Cables)

|                   | Maximum applicable motor |                            |     |                            |       |                            |       |                        |       |                        |       |
|-------------------|--------------------------|----------------------------|-----|----------------------------|-------|----------------------------|-------|------------------------|-------|------------------------|-------|
| Model SSW900      | Rated current (A)        | Motor voltage<br>220/230 V |     | Motor voltage<br>380/400 V |       | Motor voltage<br>440/460 V |       | Motor voltage<br>525 V |       | Motor voltage<br>575 V |       |
| WOULT 55W500      | А                        | HP                         | kW  | HP                         | kW    | HP                         | kW    | HP                     | kW    | HP                     | kW    |
| SSW900C0130T5E2   | 225                      | 75                         | 55  | 150                        | 110   | 175                        | 132   | 200                    | 150   | 250                    | 185   |
| SSW900C0171T5E2   | 296                      | 125                        | 90  | 200                        | 150   | 200                        | 150   | 250                    | 185   | 300                    | 220   |
| SSW900C0200T5E2   | 346                      | 150                        | 110 | 250                        | 185   | 300                        | 220   | 300                    | 220   | 350                    | 260   |
| SSW900D0255T5Ex1) | 441                      | 175                        | 132 | 300                        | 220   | 350                        | 260   | 400                    | 300   | 450                    | 330   |
| SSW900D0312T5Ex1) | 540                      | 200                        | 150 | 350                        | 260   | 450                        | 330   | 500                    | 370   | 550                    | 410   |
| SSW900D0365T5Ex1) | 631                      | 250                        | 185 | 450                        | 330   | 500                        | 370   | 600                    | 450   | 650                    | 485   |
| SSW900D0412T5Ex1) | 713                      | 250                        | 185 | 500                        | 370   | 600                        | 450   | 700                    | 525   | 800                    | 600   |
| SSW900E0480T5Ex1) | 831                      | 350                        | 260 | 600                        | 450   | 700                        | 525   | 800                    | 600   | 900                    | 670   |
| SSW900E0604T5Ex1) | 1,046                    | 450                        | 330 | 750                        | 550   | 850                        | 630   | 1,050                  | 775   | 1,150                  | 820   |
| SSW900E0670T5Ex1) | 1,160                    | 500                        | 370 | 850                        | 630   | 950                        | 700   | 1,150                  | 820   | 1,250                  | 920   |
| SSW900F0820T5Ex1) | 1,420                    | 600                        | 450 | 1,000                      | 750   | 1,200                      | 900   | 1,400                  | 1,050 | 1,550                  | 1,140 |
| SSW900F0950T5Ex1) | 1,645                    | 720                        | 520 | 1,200                      | 900   | 1,400                      | 1,030 | 1,650                  | 1,200 | 1,800                  | 1,325 |
| SSW900G1100T5Ex1) | 1,905                    | 800                        | 600 | 1,400                      | 1,030 | 1,600                      | 1,175 | 1,900                  | 1,400 | 2,100                  | 1,550 |
| SSW900G1400T5Ex1) | 2,425                    | 1,050                      | 775 | 1,750                      | 1,290 | 2,000                      | 1,475 | 2,450                  | 1,800 | 2,650                  | 1,950 |

Notes: 1) To select a SSW900 model with control voltage 110-130 V, replace "x" by 3 and to select a model with control voltage 220-240, replace "x" by 4. Models ≤412 A: AC-53b 3-25:335, ambient temperature of 55 °C;

Models ≥480 A: AC-53b 3-25:695, ambient temperature of 40 °C;

Models of 130 A to 200 A: with ventilation kit;

WEG motors Premium or Plus, IV poles.


## Accessories

| Accessory                          | Description   | Image     |
|------------------------------------|---|-----------|
|                                    | Accessories for communication and control - Slots 1 and 2                   |           |
| SSW900-CAN-W                       | CANopen and DeviceNet communication plug-in module                          |           |
| SSW900-CRS485-W                    | Modbus-RTU communication plug-in module                                     | <b>\$</b> |
| SSW900-CDN-N                       | DeviceNet - Anybus communication plug-in module                             | <b>\$</b> |
| SSW900-CPDP-N                      | Profibus-DP - Anybus communication plug-in module                           | <b>\$</b> |
| SSW900-CETH-IP-N                   | EtherNet/IP - Anybus communication plug-in module                           | <b></b>   |
| SSW900-CMB-TCP-N                   | Modbus-TCP - Anybus communication plug-in module                            | <b>\$</b> |
| SSW900-CPN-IO-N                    | PROFINET IO - Anybus communication plug-in module                           | <b>\$</b> |
| SSW900-CETH-W <sup>1)</sup>        | Ethernet/IP communication plug-in module                                    | , Â,      |
| SSW900-HMI-BLT                     | Remote operating interface with Bluetooth communication                     |           |
| SSW900-PT100-W                     | Temperature plug-in module for PT100 sensors - 6 channels                   | <b>1</b>  |
|                                    | Accessories for mechanical installation                                     |           |
| SSW900-KVT-02                      | Ventilation kit for frame B (currents from 45 to 105 A)                     |           |
| SSW900-KVT-03                      | Ventilation kit for frame C (currents from 130 to 200 A)                    |           |
| SSW900-KIP-03                      | IP20 kit for frame C (currents from 130 to 200 A)                           |           |
| SSW900-KIP-04                      | IP20 kit for frame D (currents from 255 to 412 A)                           |           |
| SSW900-PR0T-M3                     | Front cover kit for power terminals of frame C (currents from 130 to 200 A) |           |
| SSW900-PR0T-M4                     | Front cover kit for power terminals of frame D (currents from 255 to 412 A) | 1 🚍       |
| SSW900-PR0T-M5                     | Front cover kit for power terminals of frame E (currents from 480 to 670 A) |           |
|                                    | Other accessories   | <b></b>   |
| SSW900-KMD-CB01<br>SSW900-KMD-CB02 | Frame kit for HMI + 1 m cable<br>Frame kit for HMI + 2 m cable              |           |
| SSW900-KMD-CB03                    | Frame kit for HMI + 3 m cable   | -         |
| SSW900-KMD-CB05                    | Frame kit for HMI + 5 m cable   | -         |
| SSW900-KMD-CB07                    | Frame kit for HMI + 7,5 m cable   | -         |
| SSW900-KMD-CB10<br>SSW900-KMD-CB20 | Frame kit for HMI + 10 m cable<br>Frame kit for HMI + 20 m cable            | -         |
| SSW900-KMD-CB20<br>SSW900-KECA-10  | Current acquisition kit for 10 A  |           |
| SSW900-KECA-17                     | Current acquisition kit for 17 A  |           |
| SSW900-KECA-24                     | Current acquisition kit for 24 A  | -         |
| SSW900-KECA-30                     | Current acquisition kit for 30 A  | -         |
| SSW900-KECA-45                     | Current acquisition kit for 45 A  | -         |
| SSW900-KECA-61                     | Current acquisition kit for 61 A  | -         |
| SSW900-KECA-85                     | Current acquisition kit for 85 A  | -         |
| SSW900-KECA-105<br>SSW900-KECA-130 | Current acquisition kit for 105 A<br>Current acquisition kit for 130 A      | -         |
| SSW900-KECA-170                    | Current acquisition kit for 171 A   |           |
| SSW900-KECA-200                    | Current acquisition kit for 200 A   | -         |
| SSW900-KECA-255                    | Current acquisition kit for 255 A   | -         |
| SSW900-KECA-312                    | Current acquisition kit for 312 A   | -         |
| SSW900-KECA-365                    | Current acquisition kit for 365 A   | -         |
| SSW900-KECA-412                    | Current acquisition kit for 412 A   | -         |
| SSW900-6BAR-E                      | Kit with six bars for frame E (currents from 480 to 670 A)                  | -         |
| SSW900-6BAR-F                      | Kit with six busbars for frame F (currents of 820 and 950 A)                | -         |
| SSW900-3BAR-G                      | Kit with three busbars for frame G (currents of 1,100 and 1,400 A)          | -         |

Note: 1) Please check availability with your sales representative.



## Accessory Installation

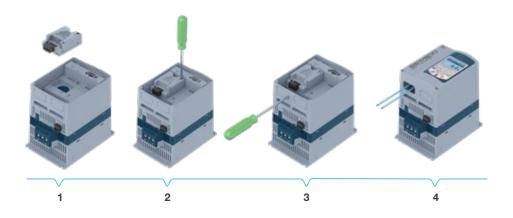

## Dimmensions





| Frame size | Height (H)<br>mm<br>(in) | Width (W)<br>mm<br>(in) | Depth (P)<br>mm<br>(in) | (A)<br>mm<br>(in) | (B)<br>mm<br>(in) | (C)<br>mm<br>(in) | (D)<br>mm<br>(in) | Fastening<br>screw | Weight<br>(kg)<br>(lb) | Degree of protection |
|------------|--------------------------|-------------------------|-------------------------|-------------------|-------------------|-------------------|-------------------|--------------------|------------------------|----------------------|
| A          | 200<br>(7.87)            | 127<br>(5)              | 203<br>(7.99)           | 110<br>(7.33)     | 175<br>(6.88)     | 8.5<br>(0.33)     | 4.3<br>(0.16)     | M4                 | 1.93<br>(4.25)         | IP20                 |
| В          | 208<br>(8.18)            | 144<br>(5.66)           | 260<br>(10.23)          | 132<br>(5.19)     | 148<br>(5.82)     | 6<br>(0.23)       | 3.4<br>(0.13)     | M4                 | 4.02<br>(8.86)         | IP20                 |
| С          | 276<br>(10.86)           | 223<br>(8.77)           | 261<br>(10.27)          | 208<br>(8.18)     | 210<br>(8.26)     | 7.5<br>(0.29)     | 5<br>(0.19)       | M5                 | 6.55<br>(14.44)        | IP20 <sup>1)</sup>   |
| D          | 331<br>(13.03)           | 227<br>(8.93)           | 282<br>(11.10)          | 200<br>(7.87)     | 280<br>(11.02)    | 15<br>(0.59)      | 9<br>(0.35)       | M8                 | 12.83<br>(28.28)       | IP20 <sup>1)</sup>   |
| E          | 575<br>(22.63)           | 390<br>(15.35)          | 260<br>(10.23)          | 270<br>(10.62)    | 480<br>(18.89)    | 56<br>(2.20)      | 10<br>(0.40)      | M8                 | 38<br>(83.75)          | IP00                 |
| F          | 760<br>(29.92)           | 464<br>(18.27)          | 316<br>(12.44)          | 320<br>(12.60)    | 625<br>(24.61)    | 72<br>(2.83)      | 10<br>(0.39)      | M8                 | 75.40<br>(166.23)      | IP00                 |
| G          | 914<br>(35.98)           | 539<br>(21.22)          | 316<br>(12.44)          | 369<br>(14.53)    | 732<br>(28.82)    | 85<br>(3.35)      | 12<br>(0.47)      | M10                | 107.20<br>(236.34)     | IP00                 |

Note: IP20 with optional kit.



## Installation

## Standard (3 Cables)



Motor in Y



Motor in  $\Delta$ 


I<sub>Soft-Starter</sub> =I<sub>Rated</sub>

## Inside Delta (6 Cables)



## Minimum Free Spaces Recommended

| Frame size | A      | B      | C      |  |  |
|------------|--------|--------|--------|--|--|
|            | mm     | mm     | mm     |  |  |
|            | (in)   | (in)   | (in)   |  |  |
| A          | 50     | 50     | 30     |  |  |
|            | (2)    | (2)    | (1.2)  |  |  |
| В          | 80     | 80     | 30     |  |  |
|            | (3.2)  | (3.2)  | (1.2)  |  |  |
| C          | 100    | 100    | 30     |  |  |
|            | (4)    | (4)    | (1.2)  |  |  |
| D          | 150    | 150    | 30     |  |  |
|            | (6)    | (6)    | (1.2)  |  |  |
| E          | 150    | 150    | 30     |  |  |
|            | (6)    | (6)    | (1.2)  |  |  |
| F          | 180    | 180    | 30     |  |  |
|            | (7.09) | (7.09) | (1.18) |  |  |
| G          | 180    | 180    | 30     |  |  |
|            | (7.09) | (7.09) | (1.18) |  |  |

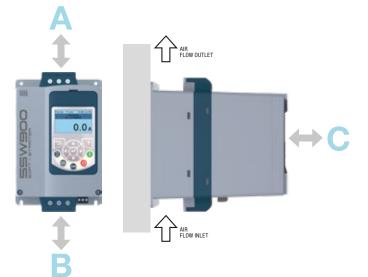



## Technical Specifications

| Power supply                     | Power voltage (R/1L1, S/3L2, T/5L3)       | 220 to 575 V ac (-15% to +10%), or 187 to 632 V ac (standard and delta connection)  |
|----------------------------------|---|---|
|                                  | Control voltage                           | 10 A to 200 A models: 110 to 240 V (-15% to +10%), or 93.5 to 264 V ac 255 to 1,400 A models: 110 to 130 V (-15% to +10%), or 93.5 to 143 V ac, or 220 to 240 V (-15% to +10%), or 176.8 to 264 V ac  |
|                                  | Frequency                                 | 50 to 60 Hz (±10%)  |
|                                  | Power consumption                         | 10 A to 200 A models: 32 VA<br>255 to 412 A models: 70 VA continuous, 700 VA additional during the closing of the internal bypass<br>480 A to 670 A models: 90 VA continuous, 700 VA additional during the closing of the internal bypass<br>Models from 820 A to 950 A: 140 VA continuous, 800 VA additional during the closing of the internal bypass<br>Models from 1,100 A to 1,400 A: 180 VA continuous, 850 VA additional during the closing of the internal bypass |
| Inputs                           | Digital                                   | 5 isolated digital inputs<br>Minimum high level: 18 V dc<br>Minimum low level: 3 V dc<br>Maximum voltage: 30 V dc<br>Input current: 11 mA @ 24 V dc<br>Programmable functions   |
|                                  | Inputs for motor thermistor               | 1 input for thermistor Actuation: 3.9 kΩ, release: 1.6 kΩ Minimum resistance 100 $\Omega$   |
| Outputs                          | Digital                                   | 2 relays with N0 contacts, 240 V ac, 1 A, programmable functions<br>1 relay with N0/NC contact, 240 V ac, 1 A, programmable functions   |
|                                  | Analog                                    | 1 analog output 0 to 10 V or 0/4 to 20 mA configurable by software  |
| HMI (Human<br>Machine Interface) | Standard HMI<br>IHM Bluetooth (accessory) | 12 keys: run/stop, forward/reverse, Jog, local/remote, navigation buttons: left, right, up, down, enter, back and help<br>Graphic LCD display<br>Allows monitoring/changing all SSW parameters<br>Possibility of external mounting, panel door<br>USB for firmware updates or communication with the product  |
| PC connection for programming    | USB connector in the HMI                  | USB standard rev. 2.0 (basic speed)<br>Mini B-type USB plug<br>Interconnecting cable: shielded USB cable, standard host/device shielded USB cable   |


## Standards

Г

| Safety  | UL508 - industrial control equipment  |  |
|---|---|--|
| standards                                     | EN60947-4-2, LVD 2006/95/EC - low-voltage switchgear and controlgear  |  |
| Electromagnetic<br>compatibility<br>standards | CISPR 11 - industrial, scientific and medical (ISM) radio-frequency equipment - electromagnetic disturbance characteristics - limits and methods of measurement<br>EN 61000-4-2 - electromagnetic compatibility (EMC) - part 4: testing and measurement techniques - section 2: electrostatic discharge immunity test<br>EN 61000-4-3 - electromagnetic compatibility (EMC) - part 4: testing and measurement techniques - section 3: radiated, radio-frequency, electromagnetic field immunity test<br>EN 61000-4-3 - electromagnetic compatibility (EMC) - part 4: testing and measurement techniques - section 3: radiated, radio-frequency, electromagnetic field immunity test<br>EN 61000-4-4 - electromagnetic compatibility (EMC) - part 4: testing and measurement techniques - section 4: electrical fast transient/burst immunity test<br>EN 61000-4-5 - electromagnetic compatibility (EMC) - part 4: testing and measurement techniques - section 5: surge immunity test<br>EN 61000-4-6 - electromagnetic compatibility (EMC) - part 4: testing and measurement techniques - section 6: immunity to conducted disturbances, induced by radio-frequency fields<br>EN 61000-4-11 - electromagnetic compatibility (EMC) - part 4: testing and measurement techniques - section 11: voltage dips, short interruptions and voltage variations immunity tests |  |
| Mechanical                                    | EN 60529 - degrees of protection provided by enclosures (IP code)   |  |
| construction                                  | UL50 - enclosures for electrical equipment  |  |
| standards                                     | IEC 60721-3-3 - classification of environmental conditions  |  |



## Block Diagram

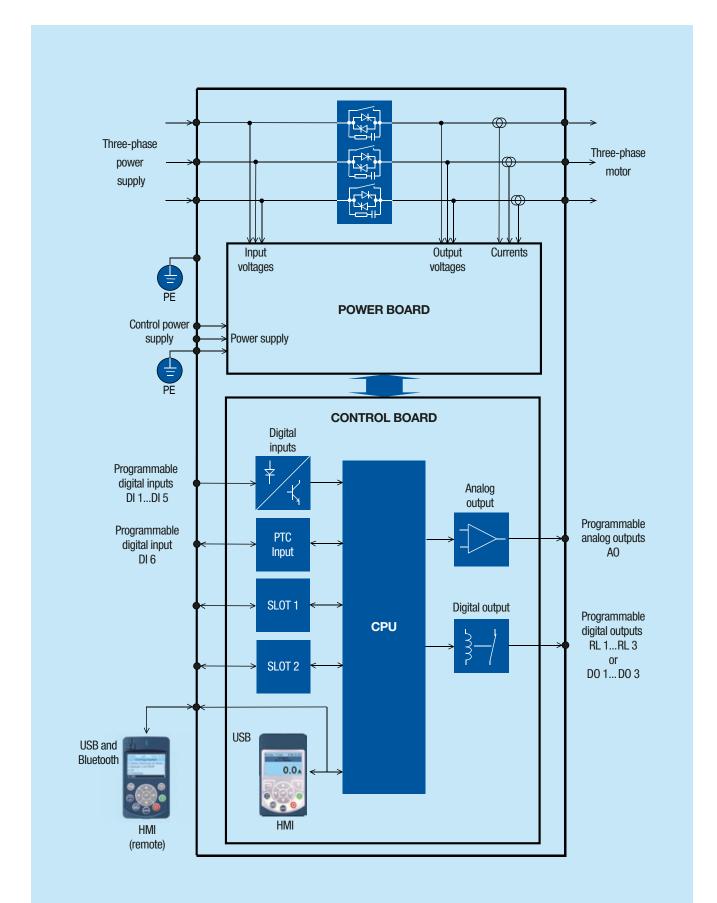

# **Global presence** is essential, as much as understanding your needs.

#### **Global Presence**

With more than 30,000 employees worldwide, WEG is one of the largest electric motors, electronic equipments and systems manufacturers. We are constantly expanding our portfolio of products and services with expertise and market knowledge. We create integrated and customized solutions ranging from innovative products to complete after-sales service.

WEG's know-how guarantees our **Soft-Starters SSW900** are the right choice for your application and business, assuring safety, efficiency and reliability.



Availability is to have a global support network



Partnership is to create solutions that suit your needs

Competitive edge is to unite technology and innovation





# **Know More**

High performance and reliable products to improve your production process.



Excelence is to provide a whole solution in industrial automation that improves our customers productivity.

Visit: www.weg.net





## www.weg.net



Cod: 50072781 | Rev: 08 | Date (m/a): 06/2020. The values shown are subject to change without prior notice. The information contained is reference values.